



ಬೆಂಗಳೂರು ನೀರು ಸರಬರಾಜು ಮತ್ತು ಒಳಚರಂಡಿ ಮಂಡಳಿ

BANGALORE WATER SUPPLY AND SEWERAGE BOARD

Office of The AEE (S)-1-1 Sub division, BWSSB, Jambu Savari Dinne, J.P.Nagar 8th Phase, Bangalore-76

NO.BWSSB/AEE(S)1-1/AE(VBL)/ 1982 /2024-25 Dated:24.02.2025

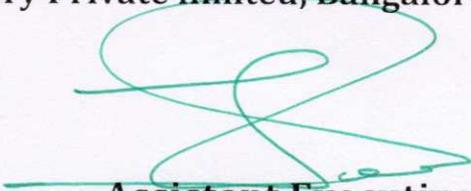
TO WHOM SO EVER IT MAY CONCERN

Sub: issue of certificate of Safe drinking water & sanitary Certificate.

Ref: Requisition letter No.3649 dated:20.02.2025.

This is to certify that The Shantiniketan Trust School situated at No.70, Bilekahalli, Bannerghatta Road, Bangalore-560076. Bearing R.R.No.S-260554 has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building and the campus.

This recommendation is based on the water sample test report issued by SLN testing Laboratory Private limited, Bangalore-560058 vide No.SLNTL2500101193


Assistant Executive Engineer
South-1-1 Sub Division, BWSSB
J.P.Nagar 8th Phase, 
Jamboosavari Dinne Main Road
Bangalore-560076

Copy: EE(S)-1 for kind information.



SLN TESTING LABORATORY PRIVATE LIMITED

An ISO 9001:2015, ISO14001:2015, ISO 45001:2018 & GLP Certified Laboratory



NO.23, JDN Layout, 10th Cross, Raghavendra Industrial Area, Thigalarapalya Main Road,
Peenya 2nd Stage, Bengaluru - 560058, Karnataka, India.

Mob : 9538888098, 9538888097, E - mail: info@slnlabs.com, Web : www.slnlabs.com

TEST REPORT

Page No. 1 of 1

Report No : SLNLT2500101193	Report Date : 30/01/2025
Issued To: Shanthinikethan Trust School Bilekahalli Bannerghatta Road, Bangalore-560076	Customer Reference : Verbal
	Date of Receipt : 27/01/2025
	Date of test start : 27/01/2025
	Date of Completion of test : 30/01/2025
Sample Submitted By : Customer	Sample Particulars : Borewell Water

Parameters	Results	Maximum Acceptable Limits (in mg/L)	Maximum Permissible Limits (in mg/L)	Test Method
		(As per IS 10500:2012)		
Colour, Hazen Units	<5	5	15	IS:3025/Part-4
Odour	Agreeable	Agreeable	Agreeable	IS:3025/Part-5
Turbidity, NTU	1.0	1	5	IS:3025/Part-10
pH Value	6.95	6.5 - 8.5	No Relaxation	IS:3025/Part-11
Total Hardness as CaCO ₃ , mg/L	245.0	200	600	IS:3025/Part-21
Calcium as Ca, mg/L	51.0	75	200	IS:3025/Part-40
Magnesium as Mg, mg/L	28.6	30	100	IS:3025/Part-46
Chloride as Cl, mg/L	69.0	250	1000	IS:3025/Part-32
Total Dissolved Solids, mg/L	430.0	500	2000	IS:3025/Part-16
Sulphate as SO ₄ , mg/L	17.2	200	400	IS:3025/Part-24
Nitrate as NO ₃ , mg/L	3.2	45	No Relaxation	IS:3025/Part-34
Fluoride as F, mg/L	0.4	1.0	1.5	IS:3025/Part-60
Iron as Fe, mg/L	0.1	0.3	No Relaxation	IS:3025/Part-53
Total Alkalinity as CaCO ₃ , mg/L	248.0	200	600	IS:3025/Part-23
Chromium as Cr ⁶⁺ , mg/L	<0.05	0.05	No Relaxation	IS:3025/Part-52
Zinc as Zn, mg/L	<0.5	5	15	IS:3025/Part-49
Copper as Cu, mg/L	<0.05	0.05	1.5	IS:3025/Part-42
Manganese as Mn, mg/L	<0.1	0.1	0.3	IS:3025/Part-59
Aluminium as Al, mg/L	<0.03	0.03	0.2	IS:3025/Part-55
Boron as B, mg/L	<0.1	0.5	1	IS:3025/Part-57
Total Coli form/100ml	Absent	Absent		IS 15185-2016
E. Coli/100ml	Absent	Absent		IS 15185-2016

Remarks: The given water sample meets to maximum permissible limits as per IS 10500:2012 for above physical, chemical and microbiological testing.

*****End of the Report*****

Authorised Signatory

- Note :**
1. The results listed pertain only to the tested samples and applicable parameters.
 2. Samples will be destroyed after 15 days from the date of issue of test certificates unless & otherwise specified and all perishable samples will be destroyed immediately after tests conducted.
 3. This report is not be reproduced either wholly or in part and can not be used an evidence in the count of law and should not be used in any advertising media without prior written permission.
 4. Sampling not done by us, unless specified.